


FIRE SAFE 3 PIECES BALL VALVE PN 100



**Lloyd's
Register**

PED 97/23/CE

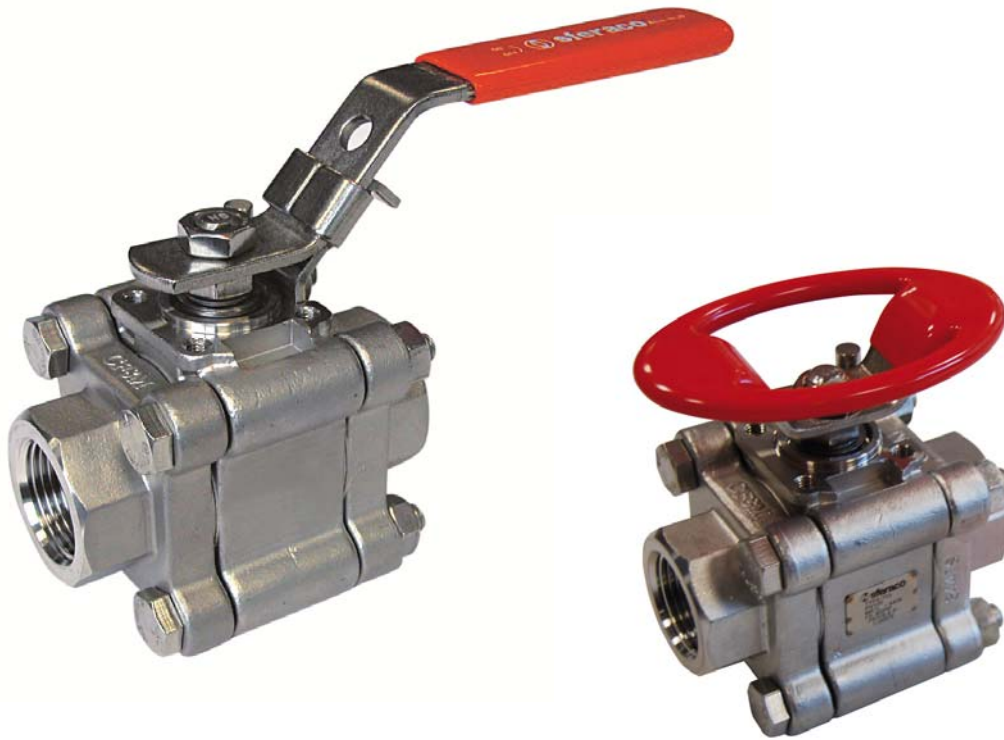

**FIRE SAFE
API 607**



Size : DN 8 to 50 mm
Ends : Threaded BSP or NPT , S.W. or B.W.
Min Temperature : -30°C in SS and -20°C in carbon steel
Max Temperature : + 218°C
Max Pressure : 100 to 140 Bars
Specifications : Antistatic device
ISO 5211 mounting pad
Anti blow-out stem
Fully encapsulated bolts
Fire safe
Atex

Materials : Carbon steel or Stainless steel

FIRE SAFE 3 PIECES BALL VALVE PN 100

SPECIFICATIONS :

- Full bore
- Anti blow-out stem
- Special gland pack with elastic washer
- Antistatic device
- Fire safe according to API 607
- Locking device
- Handwheel and stem extension (optional)
- ISO 5211 mounting pad
- Fully encapsulated bolts
- Pressure class 600 lbs


USE :

- Chemical and pharmaceutical industries, petrochemical industries, hydraulic installation, compressed air
- Steam : 12 bars maximum
- Min and max Temperatures Ts : -30°C to + 218°C for stainless steel type Ref. 703
- Min and max Temperatures Ts : -20°C to + 218°C for carbon steel type Ref. 702
- Max Pressure PN : 100 to 140 bars (see graph)

GRAPH PRESSURE / TEMPERATURE (STEAM EXCLUDED) :

PRESSURE

(BAR)

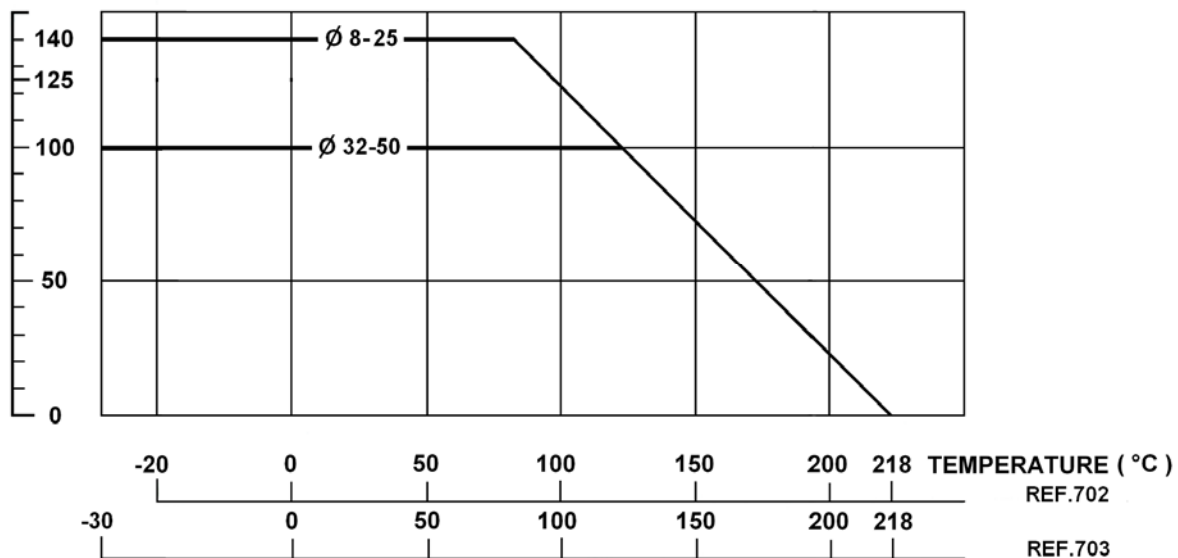

FLOW COEFFICIENT Kv (M3 / h) :

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
Kv (m3/h)	13	13.4	31.3	57.86	94.25	157.9	227.9	414.8

FIRE SAFE 3 PIECES BALL VALVE PN 100


RANGE :

- Carbon steel Ref. **702** DN 8 to DN 50
- Stainless steel Ref. **703** DN 8 to DN 50

ENDS :

- Female / female threaded BSP
- Female / female threaded NPT
- Welding S.W.
- Welding B.W.

MATERIALS :

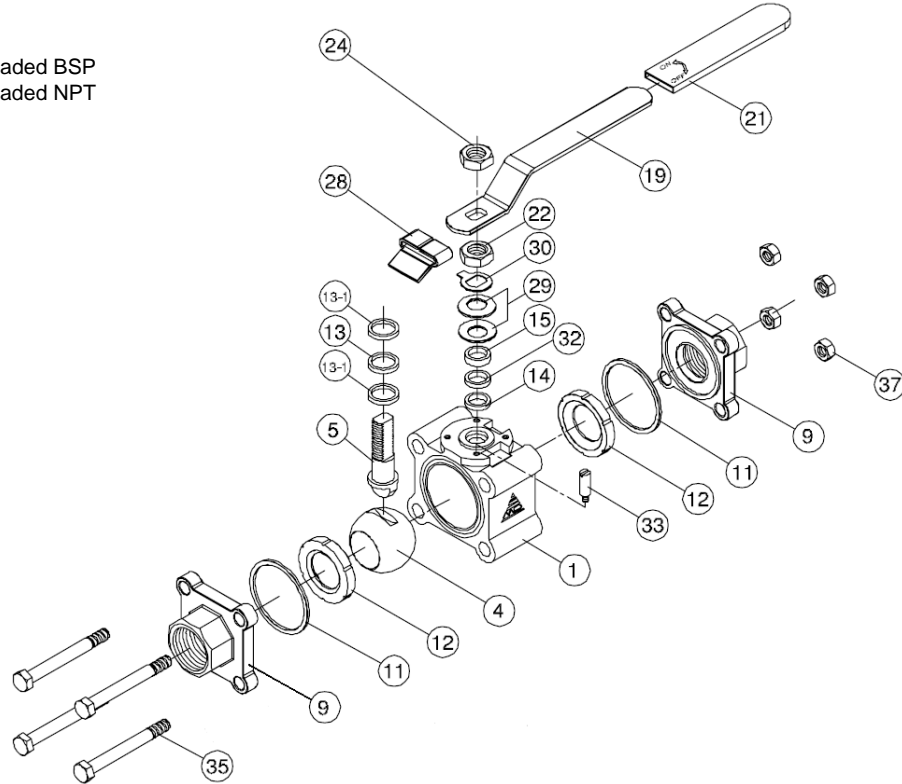


Item	Designation	Materials 702	Materials 703
1	Body	ASTM A216 WCB	ASTM A351 CF8M
4	Ball	ASTM A351 CF8M	
5	Stem	SS 316	
9	Ends	ASTM A216 WCB	ASTM A351 CF8M
11*	Body gasket	Graphite	
12*	Seat	PTFE with 15% Grafoil	
13*	Thrust washer	Graphite	
13-1*	Thrust washer	PTFE with 15% Grafoil	
14	Packing	Graphite	
15	Gland bush	SS 304	
19	Handle	SS 304	
21	Handle cover	Plastic	
22	Packing nut	SS 304	
24	Handle nut	SS 304	
28	Locking device	SS 304	
29	Elastic washer	SS 301	
30	Tab washer	SS 304	
32*	Packing follower	PTFE with 15% Grafoil	
33	Stop pin	SS 304	
35	Body bolt	SS 304	
37	Bolt nut	SS 304	

(* : included in gaskets kit)

FIRE SAFE 3 PIECES BALL VALVE PN 100


SIZE THREADED TYPES (in mm) :

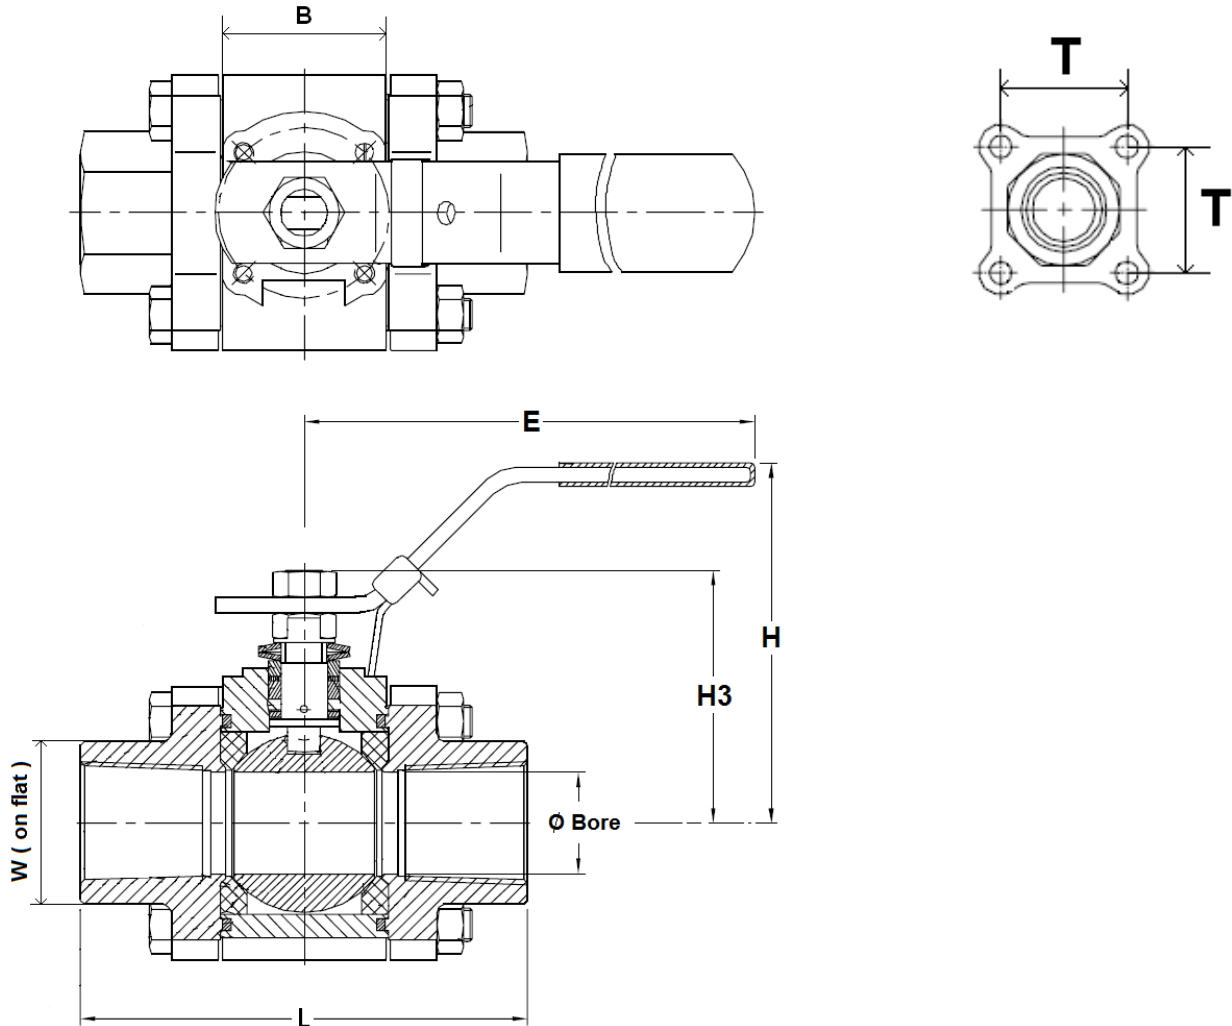


Ref.	DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
7020 / 7030 Threaded	Ø Bore	10	10	15	20	25	32	38	50
	L	64,8	64,8	72,5	85,4	105,3	111	127,3	145
	B	19,6	19,6	24	31	40,7	47,7	55,6	70
	E	134	134	134	134	170	170	207	215
	H	64	64	72	77	83	88	104	133
	H3	37,2	37,2	45,1	51,4	61,2	64,2	79	99,4
	T	32	32	39	45	50	58	68	82
	W (on flat)	29,5	29,5	30	36	44,5	54	60	73,2
	Weight (Kg)	0,70	0,70	0,85	1,37	2	2,78	4,08	6,80

FIRE SAFE 3 PIECES BALL VALVE PN 100


SIZE WELDING B.W. TYPES (in mm) :

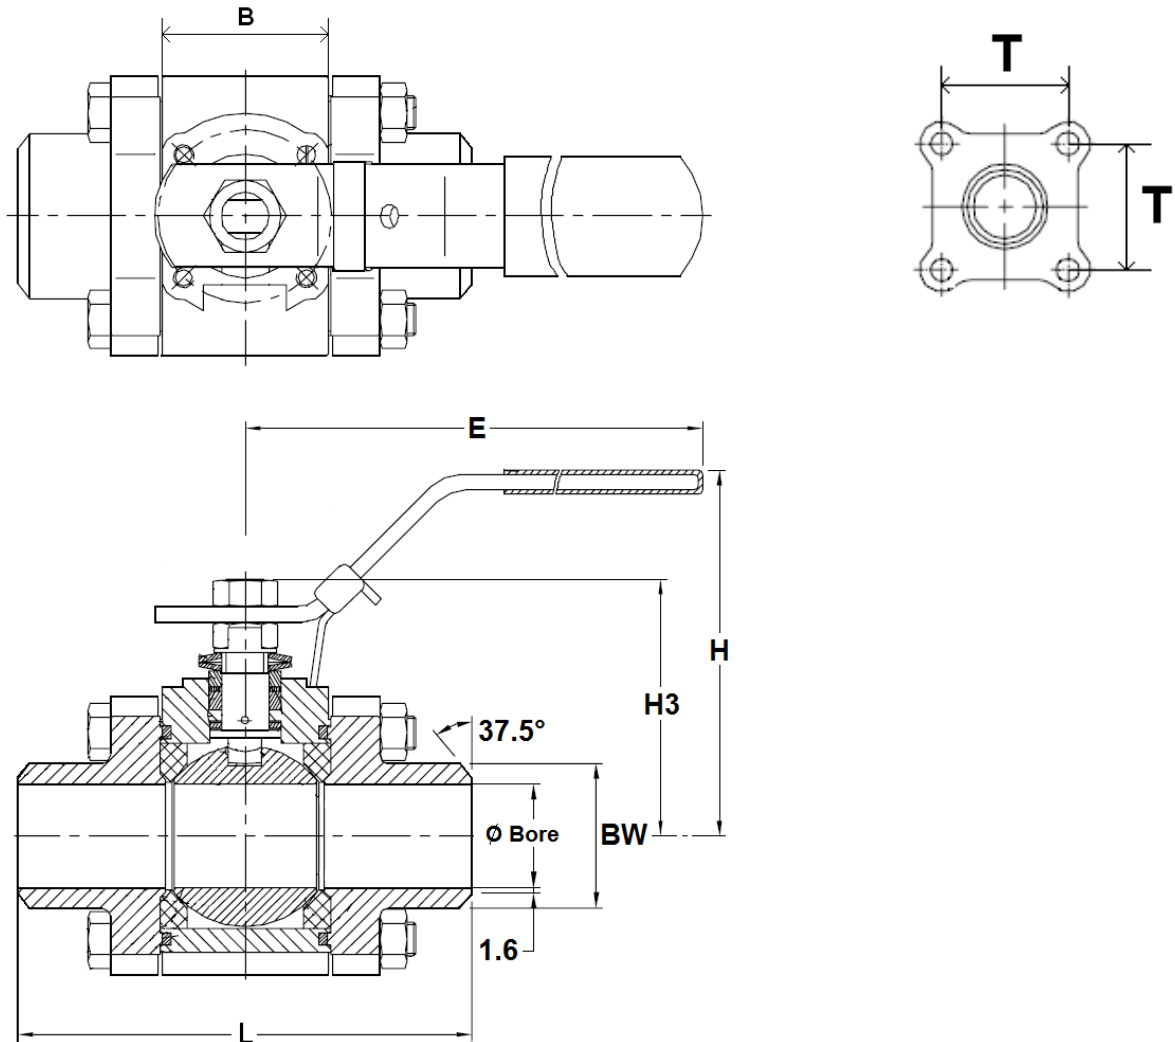

Ref.	DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
7021 / 7031 But Welding	Ø Bore	9,24	10	15	20	25	32	38	50
	L	64,8	64,8	75	90	110	115	130	145
	B	19,6	19,6	24	31	40,7	47,7	55,6	70
	E	134	134	134	134	170	170	207	215
	H	64	64	72	77	83	88	104	133
	H3	37,2	37,2	45,1	51,4	61,2	64,2	79	99,4
	T	32	32	39	45	50	58	68	82
	Ø BW	13,7	17,5	21,7	27,2	34	42,7	48,6	60,5
	Weight (Kg)	0,63	0,64	0,81	1,30	1,97	2,70	4,08	6,60

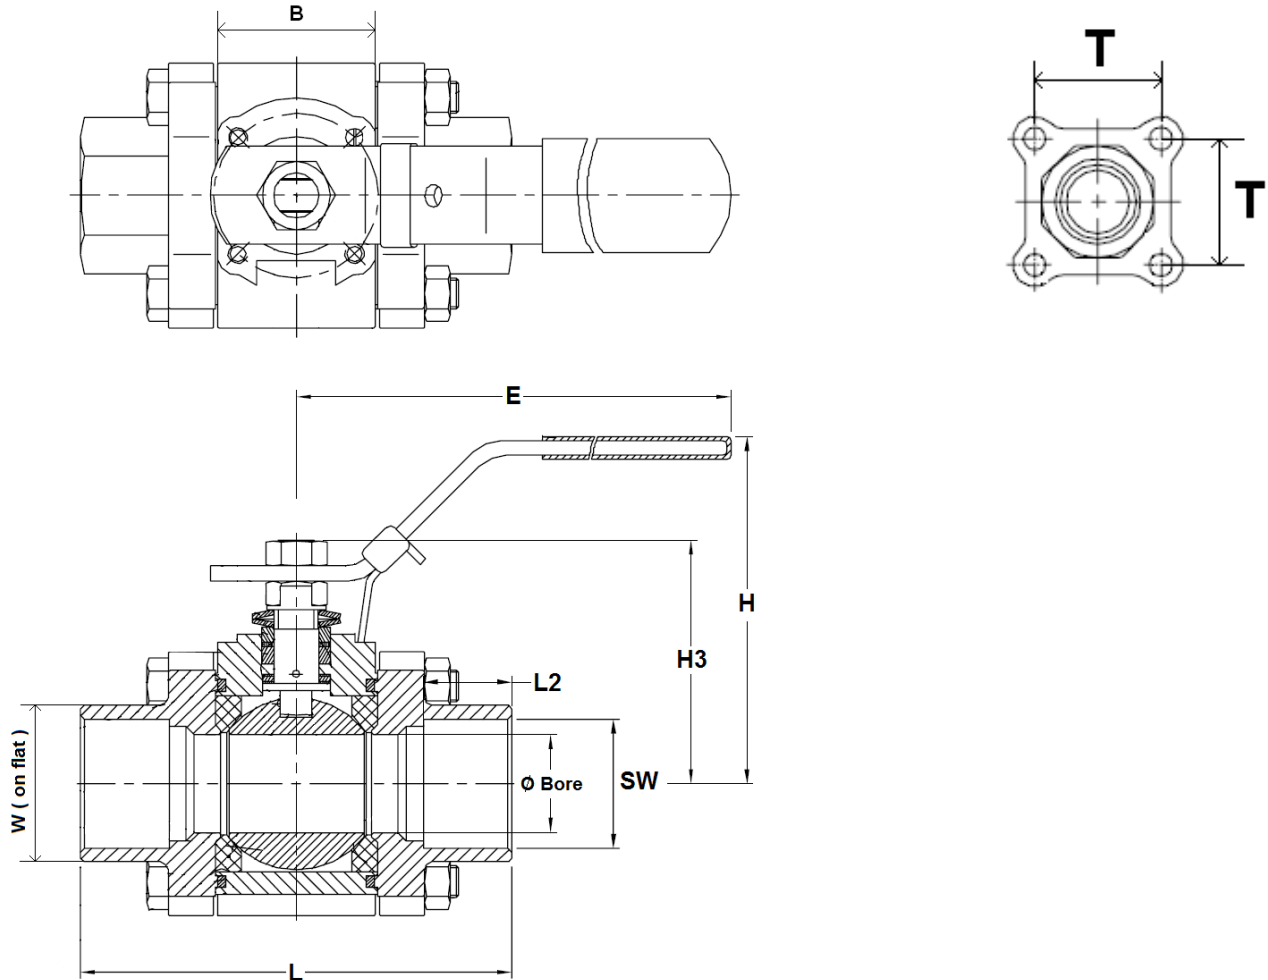FIRE SAFE 3 PIECES BALL VALVE PN 100
SIZE WELDING S.W. TYPES (in mm) :


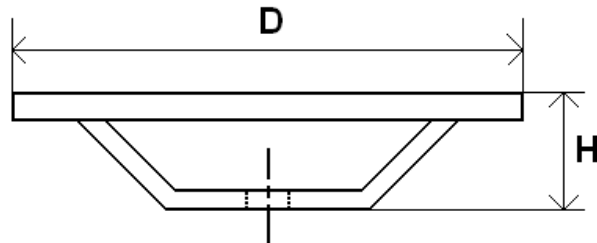
Ref.	DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
7022 / 7032 Socket Weld.	Ø Bore	10	10	15	20	25	32	38	50
	L	64,8	64,8	72,5	85,4	105,3	111	127,3	145
	B	19,6	19,6	24	31	40,7	47,7	55,6	70
	L2	10	10	10	13	13	13	13	16
	E	134	134	134	134	170	170	207	215
	H	64	64	72	77	83	88	104	133
	H3	37,2	37,2	45,1	51,4	61,2	64,2	79	99,4
	T	32	32	39	45	50	58	68	82
	W (on flat)	29,5	29,5	30	36	44,5	54	60	73,2
	Ø SW	14,3	17,6	21,9	27,3	33,9	42,8	48,9	61,3
Weight (Kg)	0,71	0,69	0,83	1,40	2	2,78	4,08	6,80	

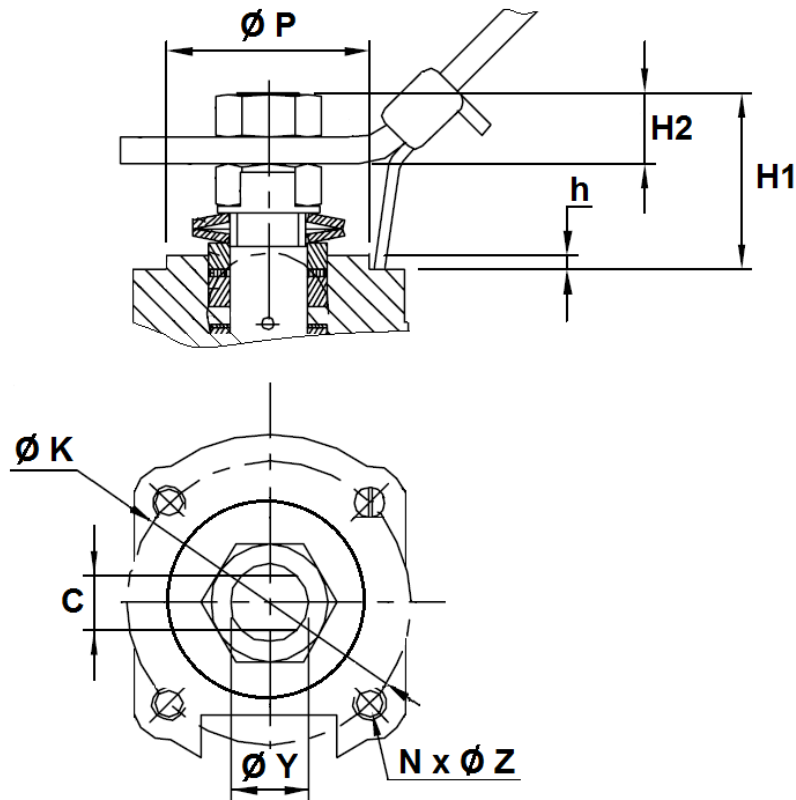FIRE SAFE 3 PIECES BALL VALVE PN 100
ISO 5211 MOUNTING PAD AND STEM SIZE (in mm) :


Ref.	DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"	
702 / 703	H1	7,4	7,4	16,1	18,4	25,2	24,2	33,4	28,1	
	H2	6,1	6,1	7,3	9,1	11,6	9,6	15	16	
	h	0,5	0,5	2	2	2	2	2,2	1,5	
	C	6,5	6,5	6,5	6,5	8	8	9,7	12	
	Ø Y	9,5	9,5	9,5	9,5	11,1	11,1	14,3	19	
	Ø P	25	25	25	25	30	30	35	55	
	Ø K	36	36	36	36	42	42	50	70	
	ISO	F03	F03	F03	F03	F03	F04	F04	F05	F07
	N x Ø Z	4x M5	4x M5	4x M5	4x M5	4x M5	4x M5	4x M5	4 x M6	4 x M8


FIRE SAFE 3 PIECES BALL VALVE PN 100

HANDWHEEL SIZE (in mm) :



DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
D	89	89	89	89	108	108	143	143
H	24	24	24	24	47	47	42	42
Weight (Kg)	0.07	0.07	0.07	0.07	0.14	0.14	0.195	0.195
Ref.	9830440	9830440	9830441	9830441	9830442	9830442	9830443	9830443

STEM EXTENTION SIZE (in mm) :

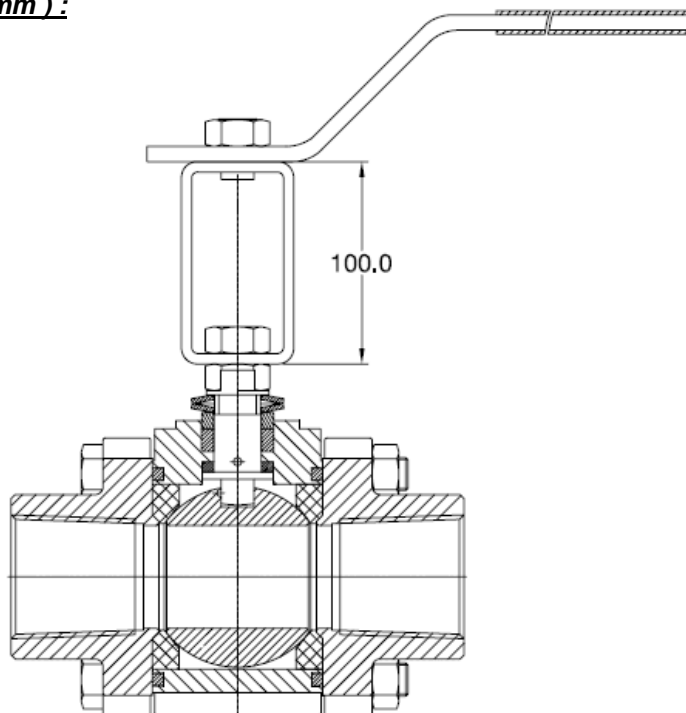

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
Ref.	9830471	9830471	9830471	9830471	9830472	9830472	9830473	9830473

FIRE SAFE 3 PIECES BALL VALVE PN 100

TORQUE VALUES (in Nm without safety coefficient) :

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
Pressure (bar)								
17	7	7	8	10	13	22	29	41
34	7	7	8	10	14	23	30	51
69	7	7	8	11	17	29	39	84
103	7	7	9	14	18	34	46	105
138	9	9	11	15	20			

BOLT TIGHTENING TABLE (in Nm) :

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4"	1"1/2"	2"
Torque (Nm)	10,8	10,8	14,7	17,6	22,5	24,5	41,2	45,1

STANDARDS :

- Fabrication according to ISO 9001 : 2008
- DIRECTIVE 97/23/CE : CE N° 0038
Risk category III module H
- Construction according to EN 12516-1 Class 600
- Designing according to ASME B16.34
- Tests according to EN12266-1, rate A
- Fire safe according to API 607 4th
- Threaded cylindrical BSPP ends according to ISO 228-1
- Threaded NPT ends according to ANSI B1.20.1
- ISO 5211 mounting pad
- ATEX Group II Category 2 G/2D Zone 1 & 21 Zone 2 & 22 (optional marking)

ADVICE : Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.

FIRE SAFE 3 PIECES BALL VALVE PN 100

INSTALLATION AND MAINTENANCE

BEFORE INSTALLATION :

Pipe-line must be cleaned and free from residual of weldings, rubbish, shaving and every kind of extraneous materials.
 Pipe-line must be perfectly aligned and their support properly dimensioned so that there's no external constraint.

Check to use a produce compatible to the services conditions for the sealing of the threaded types.
 To tighten the ends, use the appropriate tool.
 Use the right bolt tightening so that the ends won't be damaged.

The welding of the ends for the SW and the BW types, must be done with the central part removed.
 A gauge can be used to have the good length and alignment between the ends.

INSTALLATION OF THE CENTRAL PART

During the installation of the central part, tighten bolts according to the table below. Tighten bolts in cross.

BOLT TIGHTENING TABLE (in Nm) :

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
Torque (Nm)	10,8	10,8	14,7	17,6	22,5	24,5	41,2	45,1

CLEANING AND TESTS

Keep closed the valves during the cleaning operation so that there's no impurities between the ball and the body.

Tests under pressure must be done with a cleaned pipe-line.

Open partially the valve for tests. Pressure test do not exceed the valve specifications according to API 598.

MAINTENANCE

It's recommended to operate the valve twice (open and close) 1 to 2 times per year.

When intervention on the valve, be sure there's no pressure in the pipe-line, there's no fluid in it, and that it is isolated.
 The temperature must be low enough to operate without risks.
 If there's a corrosive fluid, inert installation before intervention.

When the valve is under pressure :

If there's a leakage between the body and the ends, tighten bolts according to the above table

If there's a leakage at the packing, tighten it slightly so that the leakage disappears.

MAINTENANCE OPERATION IN WORKSHOP

REPLACEMENT OF SEAT GASKETS AND PACKING.

The central part must be removed.

Turn the ball at 45° and removed the seat gaskets.

Operate the valve in closed position to removed the ball. Verify the surface of the ball has no impacts and no scores.

If there are important scores or impacts, replace the ball.

Clean inside the body valve and remove the impurities.

To replace the packing, remove the handle, unscrew the gland nut, extract the stem by the inside of the valve.

Clean the packing seat.

Reassemble thrust washer on stem, introduce stem by the inside of the valve, reassemble packing with packing nut, reassemble hand washer, hand nut and the handle.

Turn stem in closed position and insert the ball.

Then turn the ball in opened position and reassemble the seat.

Place the valve on the installation, tighten bolts according to the above table.

Then proceed to the tests in the same way that the first installation.